

Number	18-002349-PR02 (NW Z01-A01-04-en-01)
Owner	EXALCO S.A. 5th Km of National Road Larisa-Athens 41110 Larisa Greece
Product	Lifting sliding door
Designation	Shipping name: ALbio 256 Thea
Details	Manufacturer EXALCO S.A., - Larisa; Material Aluminium system with thermal break; Type of opening Lifting-sliding window; Overall dimensions (W x H) 1735 mm x 2115 mm; Rebate seal levels 4; Rebate seal levels Brush, EPDM, EPDM, Brush; Mass, area-related 59.1 kg/m <sup>2</sup> ; Number of sashes 1; IGU: Glass configuration LSG acoustic 12 mm / 10 mm / LSG acoustic 10 mm; Type of Gas Air; Frame: Projected width 49 mm; Structural depth 139.7 mm; Sash: Projected width 56 mm; Structural depth 60.3 mm
Special features	Due to the installation situation on the building site (frame covered by plastering), the frame was covered with plastic sealant during the test

## Result

Weighted Sound Reduction Index  $R_w$  and Spectrum-Adaptation Terms  $C$  and  $C_{tr}$  according to EN ISO 10140-2:2010-09, EN ISO 717-1:2013-03




$$R_w (C; C_{tr}) = 41 (-1; -5) \text{ dB}$$

## Basis \*)

EN ISO 10140-2:2010-09  
EN ISO 717-1:2013-03  
EN ISO 10140-1:2016-08  
\*) and corresponding national versions  
e.g. DIN EN

Test report: 18-002349-PR02 PB  
Z01-A01-04-en-01

## Representation

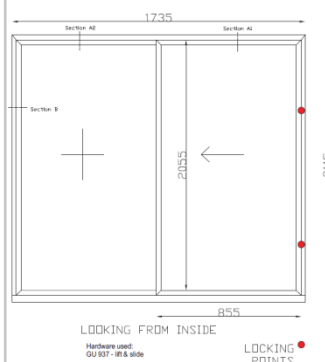

## Instructions for use

The results obtained can be used as evidence in accordance with the above basis.

## Validity

There is no time limit.  
When using this document the up-to-dateness of above basis and the conformity of the product have to be observed.

## Notes on publication

The ift-Guidance Sheet "Conditions and Guidance for the Use of ift Test Documents" applies.

ift Rosenheim  
10.12.2018



Dr. Joachim Hessinger, Dipl.-Phys.  
Head of Testing Department  
Building Acoustics



Florian Brechleier, MSc, Dipl.-Ing. (FH)  
Operating Testing Officer  
Building Acoustics

Identity-Check



[www.ift-rosenheim.de/ift-geprueft](http://www.ift-rosenheim.de/ift-geprueft)  
ID: CD3-0E250